

## PLAN VIEW

NOT TO SCALE


SEE PLAN FOR ALL DIMENSIONS

### Perforated Pipe

PVC SCH 40  $\frac{3}{8}$ " Holes 4" O.C.  
90° Around Pipe


### Notes:

1. Manufactured Sand Is Not Acceptable In Drywells.
2. All Pipes Should Be Sch.40 Pvc 4" Min.
3. Dry Wells Must Be Located A Minimum Of:
  - 20' From Building Foundation
  - 30' From Septic Field
  - 100' From Well Location
 And Should Be Located To Minimize Any Basement Seepage.

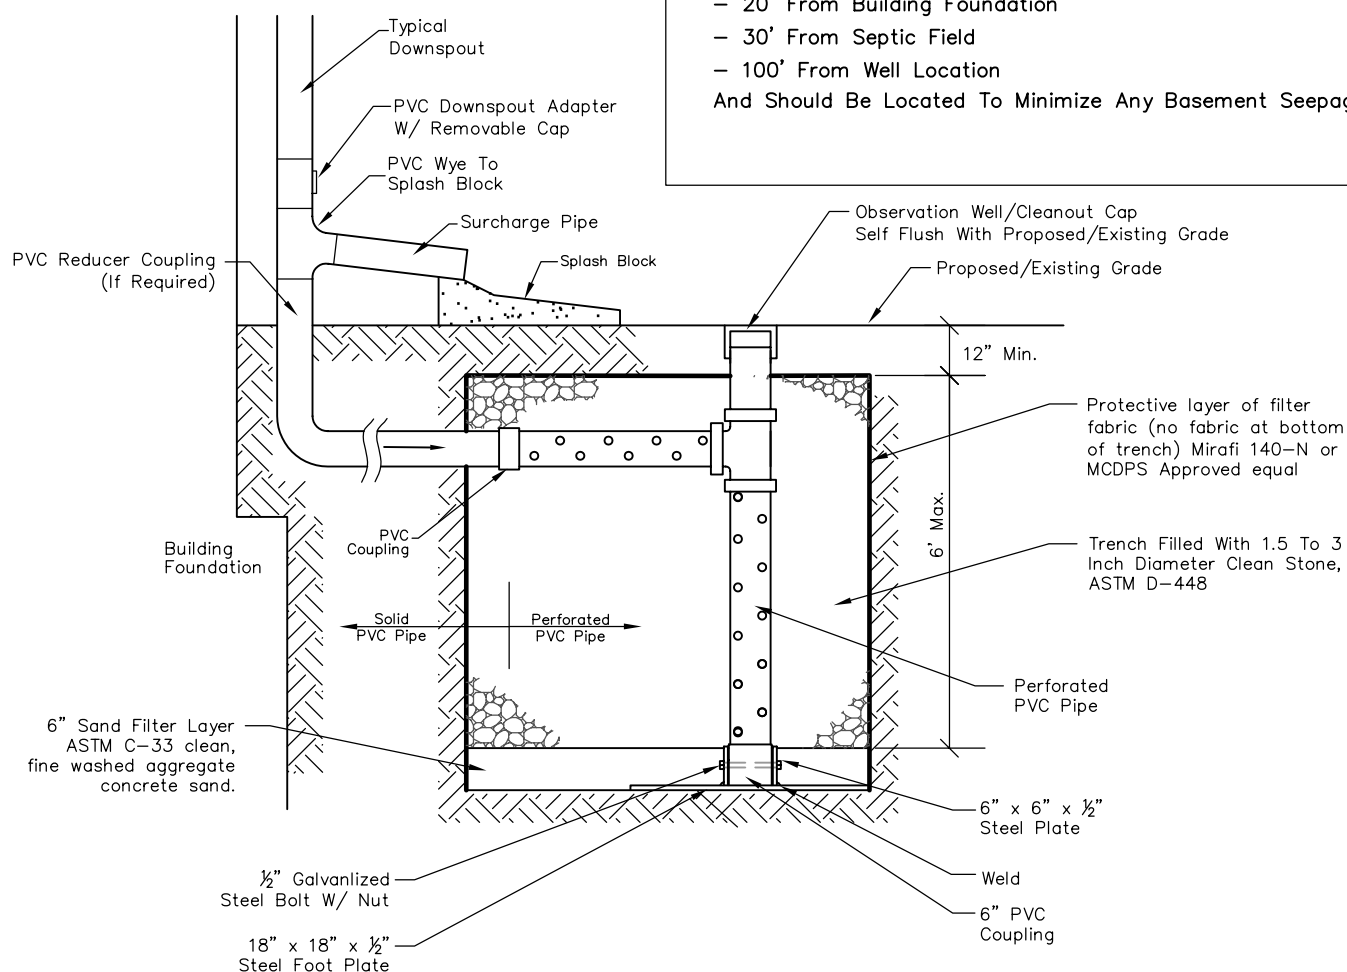

## TYPICAL SECTION

NOT TO SCALE



MONTGOMERY COUNTY  
DEPARTMENT OF PERMITTING  
SERVICES  
WATER RESOURCES

DRYWELL  
FOR  
ROOFDRAIN

DATE: 12/04

SCALE: NONE